



Picasso Lighting

IES INDOOR REPORT

PHOTOMETRIC FILENAME : BLD-2-PD-4-D5-I3-40-80-FW-W.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
[TEST] 13313159.01
[TESTLAB] UL Verification Services Inc.
[ISSUE DATE] 11/13/2023JS
[MANUFACTURER] Picasso Lighting Industries
[LUMEN CATEGORY] BLD-2-PD-4-D5-I3-40-80-FW-W
[LUMINAIRE] Formed White aluminum housing, plastic lens enclosures
[LAMP] 96 White LEDs down, 96 White LEDs up
[BALLAST] Two ERP PSB50W-1200-42-S Driver
[OTHER] 24.4 C, 119.989 V, 0.476329 A, 40.3 W, 0.974777 PF, 59.9705
[MORE] Hz
[OTHER] This test was performed using the calibrated photodetector met
[MORE] hod of absolute photometry.

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	3500
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	87
Total Luminaire Watts	40.3
Ballast Factor	1.00
CIE Type	General Diffuse
Spacing Criterion (0-180)	N.A.
Spacing Criterion (90-270)	N.A.
Spacing Criterion (Diagonal)	N.A.
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	4.00 ft
Luminous Width (90-270)	0.13 ft
Luminous Height	0.33 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	11087	4496	3780
55	10396	3566	2989
65	9336	2685	2268
75	7763	1847	1601
85	5791	1168	1080

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BLD-2-PD-4-D5-I3-40-80-FW-W.IES

CANDELA TABULATION

	<u>0.0</u>	<u>22.5</u>	<u>45.0</u>	<u>67.5</u>	<u>90.0</u>
0.0	592.25	592.25	592.25	592.25	592.25
2.5	588.77	589.94	592.70	594.06	593.73
5.0	585.30	587.64	593.15	595.88	595.22
7.5	581.82	585.32	593.60	597.68	596.70
10.0	578.35	583.01	594.06	599.50	598.18
12.5	570.72	577.69	587.90	593.32	592.15
15.0	563.10	572.36	581.76	587.16	586.11
17.5	555.48	567.06	575.61	580.99	580.08
20.0	547.85	561.73	569.47	574.82	574.04
22.5	535.01	549.79	558.65	565.46	565.67
25.0	522.16	537.87	547.81	556.10	557.29
27.5	509.33	525.92	536.99	546.74	548.92
30.0	496.48	513.99	526.17	537.37	540.53
32.5	480.68	497.70	512.12	523.88	527.52
35.0	464.88	481.42	498.08	510.36	514.52
37.5	449.07	465.12	484.03	496.87	501.52
40.0	433.26	448.82	469.99	483.36	488.51
42.5	414.05	429.98	452.48	466.65	471.96
45.0	394.85	411.12	434.96	449.95	455.40
47.5	375.63	392.26	417.45	433.23	438.83
50.0	356.42	373.42	399.93	416.53	422.28
52.5	333.30	351.80	379.41	396.43	402.66
55.0	310.21	330.18	358.89	376.32	383.04
57.5	287.09	308.55	338.38	356.22	363.41
60.0	263.98	286.95	317.85	336.12	343.79
62.5	240.10	263.59	295.18	314.15	321.49
65.0	216.21	240.24	272.50	292.17	299.19
67.5	192.32	216.88	249.82	270.20	276.86
70.0	168.44	193.53	227.15	248.22	254.56
72.5	145.44	171.04	205.23	226.44	232.70
75.0	122.44	148.54	183.32	204.67	210.84
77.5	99.45	126.03	161.42	182.89	188.97
80.0	76.44	103.53	139.50	161.11	167.10
82.5	61.13	88.59	124.64	146.17	152.37
85.0	45.80	73.66	109.79	131.24	137.65
87.5	30.46	58.72	94.92	116.30	122.92
90.0	15.14	43.79	80.06	101.37	108.19
92.5	21.35	53.32	98.22	125.67	133.88
95.0	24.92	51.67	94.41	121.29	129.16
97.5	31.21	49.86	91.47	117.22	124.78
100.0	39.23	51.54	88.53	114.34	121.29
102.5	50.76	68.50	86.90	113.55	120.66
105.0	62.28	99.54	86.71	111.61	119.08
107.5	73.88	135.74	93.46	109.14	116.45
110.0	85.26	154.53	114.90	108.89	114.78
112.5	96.85	168.29	160.81	114.17	115.32
115.0	107.81	180.47	227.88	132.49	122.37
117.5	118.77	191.20	312.85	181.53	147.02
120.0	129.57	200.74	367.75	256.86	201.69
122.5	140.52	209.51	395.05	363.89	285.23
125.0	151.31	217.34	407.16	479.29	402.94
127.5	161.78	224.61	413.86	542.74	522.73
130.0	171.86	231.56	417.94	569.94	588.70
132.5	181.64	238.30	419.67	577.51	614.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BLD-2-PD-4-D5-I3-40-80-FW-W.IES

CANDELA TABULATION - (Cont.)

135.0	191.18	244.52	418.76	577.29	620.76
137.5	200.48	250.08	414.92	572.19	619.25
140.0	209.31	255.17	408.55	562.12	610.90
142.5	217.97	260.26	399.79	546.48	596.14
145.0	226.08	264.71	390.03	525.99	575.28
147.5	234.03	268.52	379.31	502.09	548.98
150.0	241.10	271.30	367.95	476.36	519.20
152.5	247.62	274.23	356.73	450.14	487.73
155.0	253.42	276.30	345.35	424.25	456.11
157.5	258.83	277.95	333.81	398.66	424.94
160.0	263.44	278.73	322.51	374.19	395.21
162.5	267.50	279.52	313.70	353.85	369.67
165.0	270.92	279.84	305.78	335.17	346.36
167.5	273.86	279.83	298.57	318.79	325.98
170.0	276.33	279.83	292.15	304.71	308.63
172.5	278.39	279.83	287.22	294.85	296.78
175.0	279.75	279.75	283.41	287.94	287.95
177.5	280.62	279.67	281.41	283.72	282.85
180.0	280.49	280.49	280.49	280.49	280.49

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BLD-2-PD-4-D5-I3-40-80-FW-W.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	220.23	N.A.	6.30
0-30	472.09	N.A.	13.50
0-40	782.27	N.A.	22.40
0-60	1430.74	N.A.	40.90
0-80	1879.48	N.A.	53.70
0-90	1990.25	N.A.	56.90
10-90	1933.78	N.A.	55.30
20-40	562.03	N.A.	16.10
20-50	894.52	N.A.	25.60
40-70	911.58	N.A.	26.00
60-80	448.74	N.A.	12.80
70-80	185.63	N.A.	5.30
80-90	110.77	N.A.	3.20
90-110	196.36	N.A.	5.60
90-120	366.66	N.A.	10.50
90-130	667.02	N.A.	19.10
90-150	1231.6	N.A.	35.20
90-180	1509.48	N.A.	43.10
110-180	1313.13	N.A.	37.50
0-180	3499.74	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	56.47
10-20	163.77
20-30	251.86
30-40	310.18
40-50	332.48
50-60	315.98
60-70	263.11
70-80	185.63
80-90	110.77
90-100	91.82
100-110	104.54
110-120	170.30
120-130	300.37
130-140	316.70
140-150	247.88
150-160	162.71
160-170	87.82
170-180	27.36

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BLD-2-PD-4-D5-I3-40-80-FW-W.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62	57
1	98	93	89	85	91	87	83	79	75	72	69	63	61	59	53	52	50	45
2	89	81	74	68	82	75	69	64	65	60	56	55	51	48	46	43	41	37
3	81	70	62	56	74	66	58	53	56	51	46	48	44	40	40	37	34	31
4	74	62	53	47	68	58	50	44	50	44	39	43	38	34	36	32	29	26
5	67	55	46	40	62	51	44	38	44	38	34	38	33	29	32	28	25	22
6	62	49	41	35	57	46	38	33	40	34	29	34	29	26	29	25	22	19
7	57	44	36	30	53	42	34	29	36	30	25	31	26	22	26	22	19	17
8	53	40	32	27	49	38	30	25	33	27	23	28	23	20	24	20	17	15
9	49	37	29	24	46	34	27	22	30	24	20	26	21	18	22	18	16	13
10	46	34	26	21	43	32	25	20	28	22	18	24	19	16	21	17	14	12

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BLD-2-PD-4-D5-I3-40-80-FW-W.IES

UGR TABLE - CORRECTED


Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	11.7	12.7	12.6	13.6	14.8	15.3	16.3	16.2	17.2	18.4
	3H	13.0	13.9	13.9	14.8	16.0	17.6	18.5	18.5	19.4	20.6
	4H	13.4	14.2	14.3	15.1	16.3	18.6	19.5	19.5	20.4	21.6
	6H	13.6	14.4	14.5	15.3	16.5	19.6	20.4	20.5	21.3	22.5
	8H	13.7	14.4	14.6	15.3	16.6	20.1	20.8	21.0	21.8	23.0
	12H	13.7	14.4	14.6	15.3	16.6	20.6	21.3	21.6	22.3	23.5
4H	2H	12.6	13.4	13.5	14.3	15.5	15.5	16.3	16.4	17.3	18.5
	3H	14.0	14.7	15.0	15.7	16.9	17.9	18.6	18.8	19.6	20.8
	4H	14.5	15.2	15.5	16.1	17.4	19.0	19.7	20.0	20.6	21.9
	6H	14.9	15.4	15.8	16.4	17.6	20.2	20.7	21.1	21.7	22.9
	8H	14.9	15.5	15.9	16.4	17.7	20.7	21.2	21.7	22.2	23.5
	12H	15.0	15.5	16.0	16.5	17.7	21.3	21.8	22.3	22.8	24.1
8H	4H	15.1	15.6	16.0	16.6	17.8	19.1	19.6	20.0	20.6	21.8
	6H	15.5	16.0	16.5	17.0	18.2	20.3	20.7	21.3	21.7	23.0
	8H	15.7	16.1	16.7	17.1	18.3	20.9	21.3	21.9	22.3	23.6
	12H	15.8	16.1	16.8	17.1	18.4	21.7	22.0	22.7	23.0	24.3
12H	4H	15.2	15.6	16.1	16.6	17.9	19.1	19.5	20.0	20.5	21.8
	6H	15.7	16.1	16.7	17.1	18.4	20.3	20.7	21.3	21.7	23.0
	8H	15.9	16.3	16.9	17.3	18.6	21.0	21.3	22.0	22.3	23.6

Maximum UGR = 24.3

POLAR GRAPH

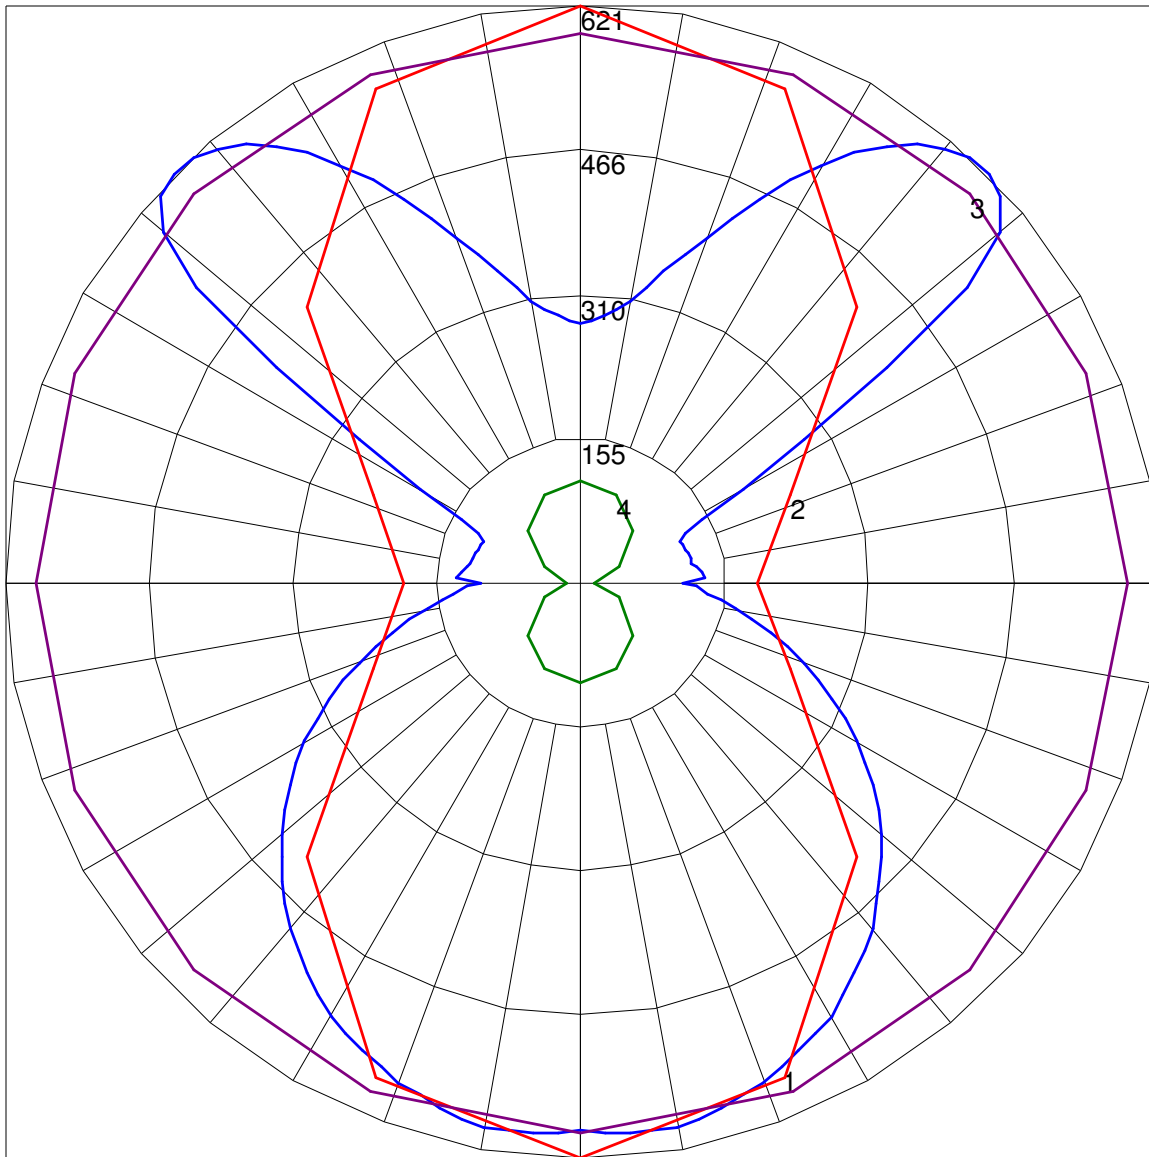

Maximum Candela = 620.76 Located At Horizontal Angle = 90, Vertical Angle = 135
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (135) (Through Max. Cd.)
3 - Horizontal Cone Through Vertical Angle (2)
4 - Horizontal Cone Through Vertical Angle (90)